

CWA Effluent Charts

Search Criteria

Permit ID: MDG913232

Discharge points:

Parameters:


Monitoring locations: Effluents only

Outfall types: Effluents only

Sampling periods:

Charts selection: Charts with violations

Dates: 2007.04.01 – 2010.03.31



MARLEY RUN WWTP-J&H PROP,INC.

Permit ID: MDG913232

Address: UNKNOWN
MD

Status: Admin continued

Designation:

Owner/Operator: Municipal or water district


Database: ICIS-NPDES

BOD, 5-day, 20 deg. C

[Legend Help](#)

Parameter	Discharge Point	Monitoring Location	Sampling Period
BOD, 5-day, 20 deg. C	001	Effluent gross	Monthly

[View detail](#)

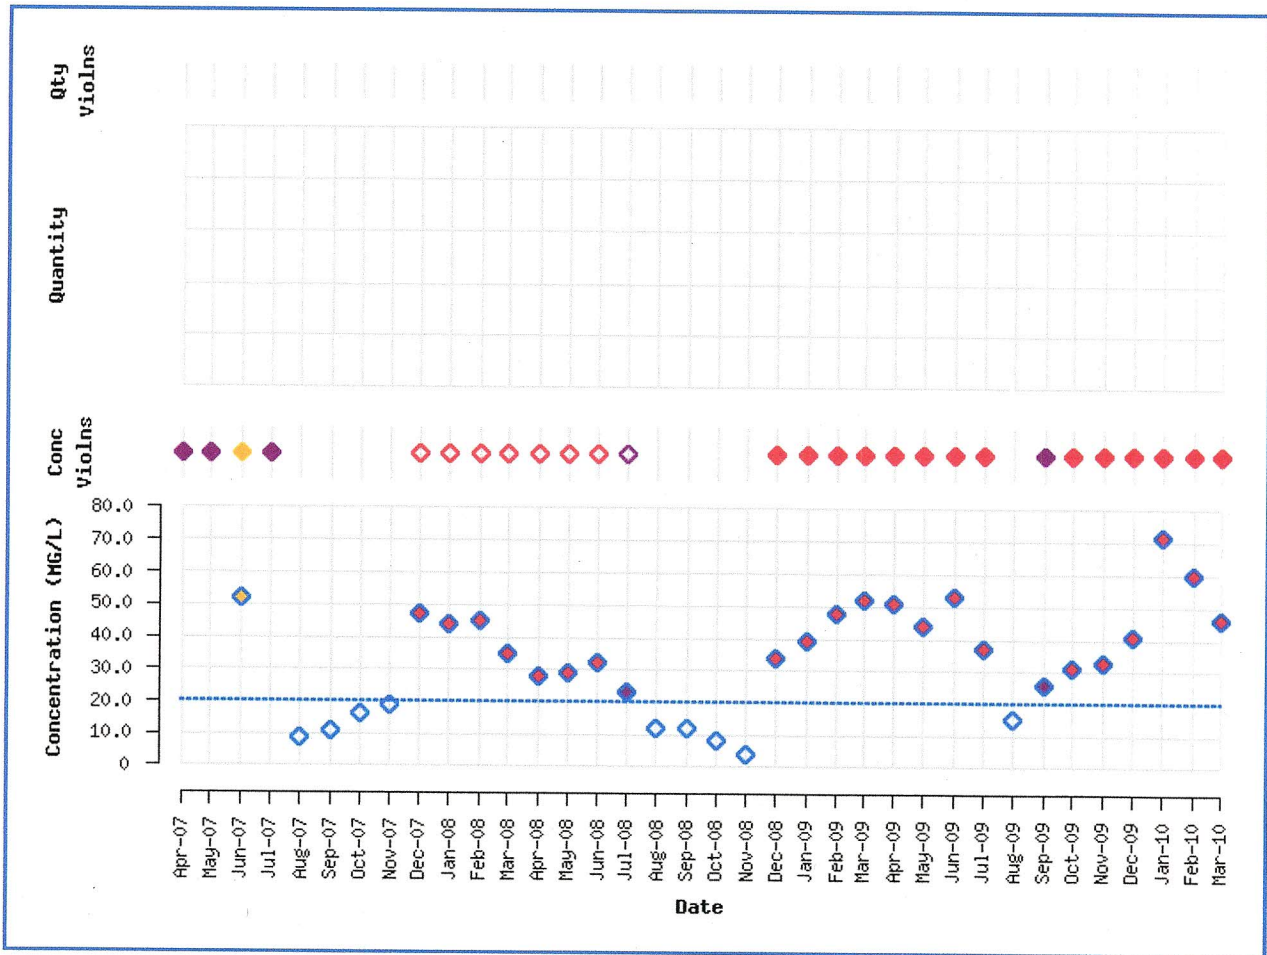


Flow, in conduit or thru treatment plant

[Legend](#) [Help](#)

Parameter	Discharge Point	Monitoring Location	Sampling Period
Flow, in conduit or thru treatment plant	001	Effluent gross	Monthly

[View detail](#)

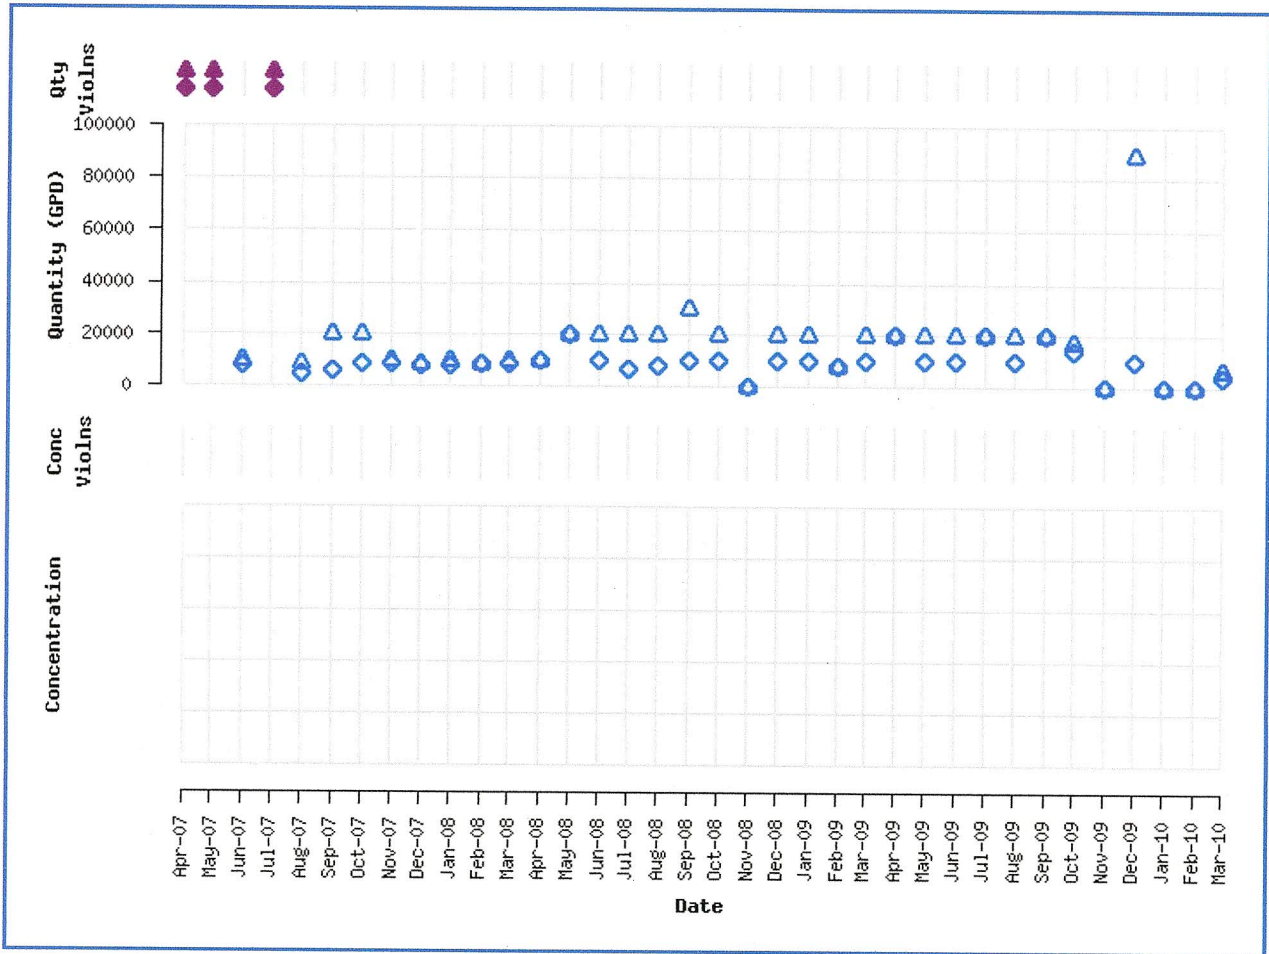


Nitrogen, total (as N)

[Legend](#) [Help](#)

Parameter	Discharge Point	Monitoring Location	Sampling Period
Nitrogen, total (as N)	001	Effluent gross	Monthly

[View detail](#)

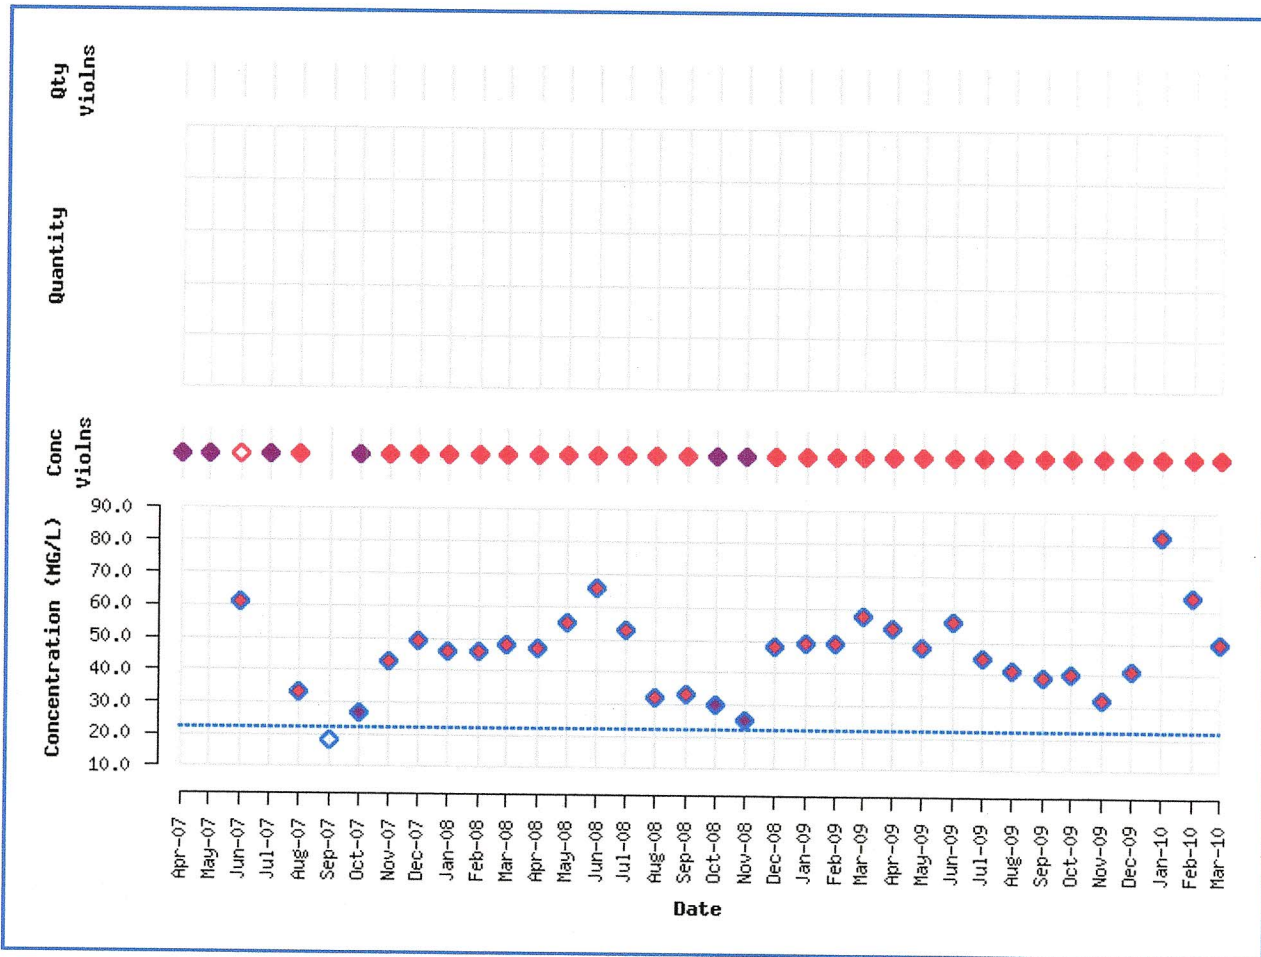


Solids, total suspended

[Legend](#) [Help](#)

Parameter	Discharge Point	Monitoring Location	Sampling Period
Solids, total suspended	001	Effluent gross	Monthly

[View detail](#)

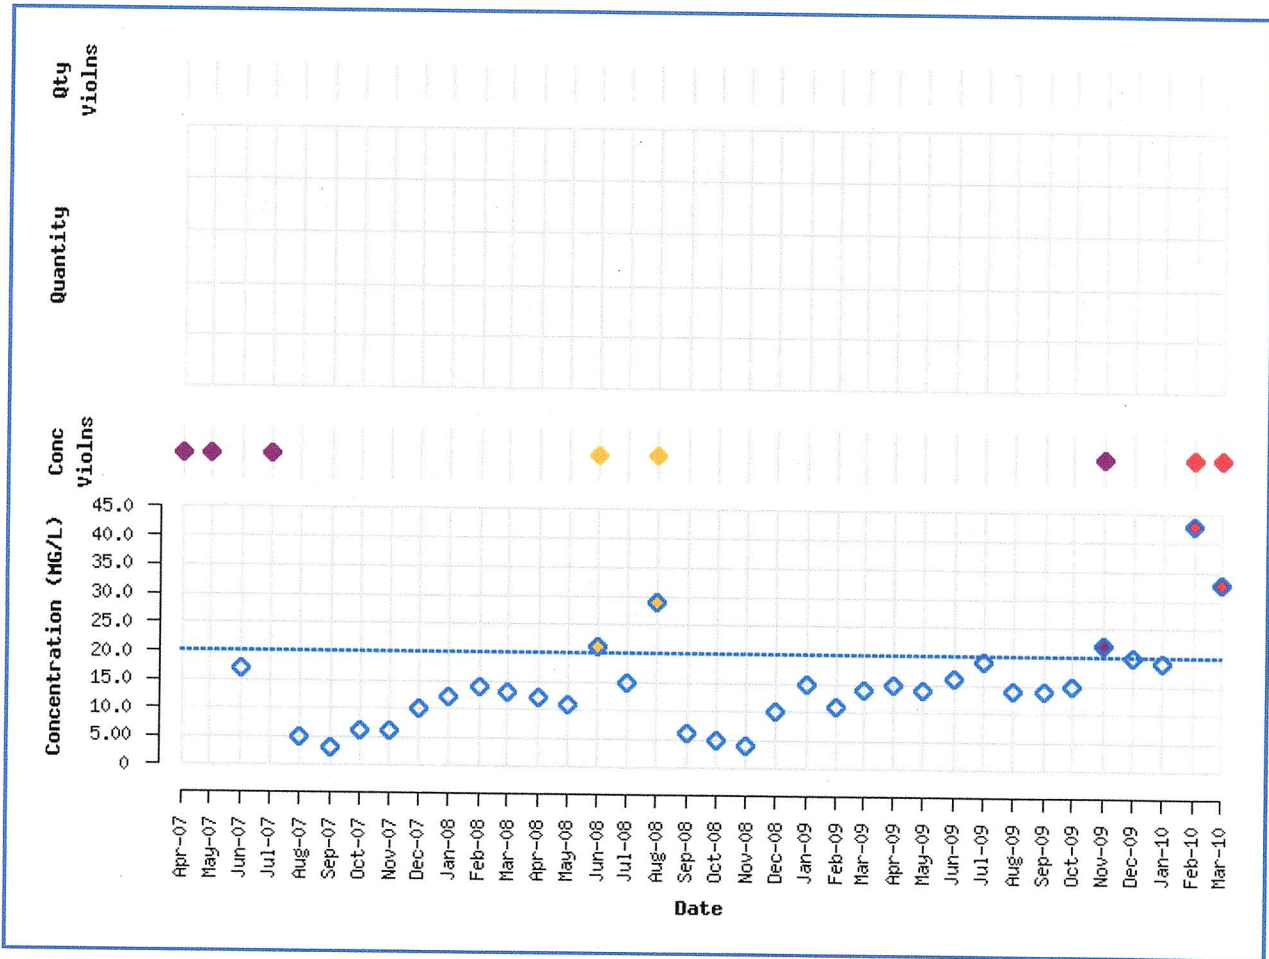

Search Criteria

Permit ID: MDG913232

Discharge points:

Parameters:

Monitoring locations: Effluents only

Outfall types: Effluents only

Sampling periods:

Charts selection: Charts with violations

Dates: 2007.04.01 – 2010.03.31

[Revise search](#)

[Download](#)